

# **Specification**


- \* Power supply: 100~240VAC 50/60Hz
- \* Standby Power Consumption: ≤2W
- \* Display accuracy: 0.1°C
- \* Temperature setting step:  $0.5^{\circ}$ C
- \* Communication: Modbus 485/ 2.4G WIFI
- \* Displayed temperature range: 0~70°C
- \* Operating temperature range: 0~50°C
- \*Temperature setting range: 5~35°C

# **Display**




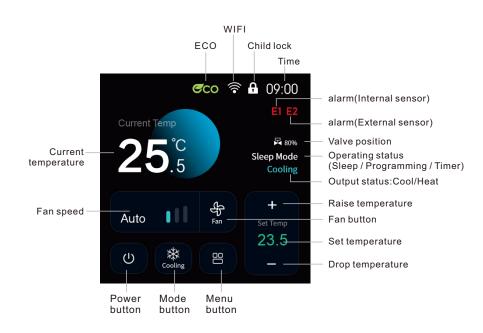


### Installation

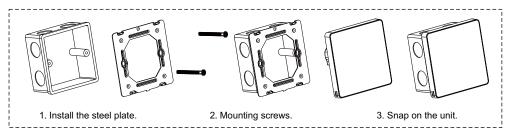

### Dimension



### Wiring diagram

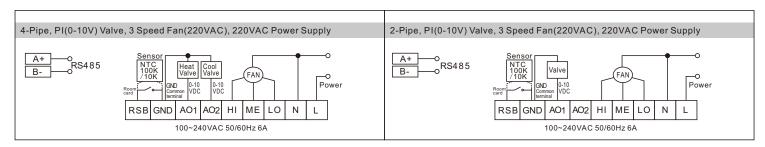

## **Programming setting (Default)**

When the system is set to programmable mode, you can configure the schedule here.



Default programming (6 period per day)

#### Default setting(Cooling)


Monday	Morning		Out	door	Back home		Out door		Back home		Sleep	
Sunday	7:00	24°C	8:00	28°C	12:00	24°C	14:00	28°C	18:00	24°C	22:00	26°C

#### Default setting(Heating)

Monday	Morning		Out	door	Back home		Out door		Back home		Sleep	
Sunday	7:00	21°C	8:00	16°C	12:00	21°C	14:00	16°C	18:00	21°C	22:00	16°C

## **Timer setting**

When the system is set to timer mode, you can configure the schedule here. It could switch thermost at on/off based on setting time.

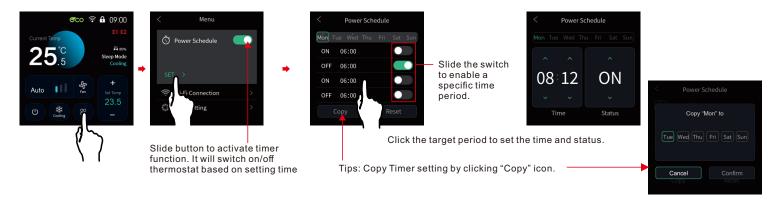

# Sleep mode setting


When the system is set to sleep mode, you can configure the schedule here.

Cooling mode: To promote more comfortable sleep and reduce energy consumption, the setpoint temperature will automatically increase by 1°C after one hour during sleep mode is activated. After two hours, the setpoint will increase by 2°C and remain at this temperature until sleep mode is automatically canceled after a total of 8 hours. Once this period ends, the setpoint temperature will automatically return to its original preset value.


Heating mode: To ensure comfortable sleep while saving energy, the setpoint temperature will automatically decrease by 1°C after one hour aduring sleep mode is activated. After two hours, the setpoint will decrease by 2°C and maintain that temperature until sleep mode is automatically canceled after a total of 8 hours. When this time elapses, the setpoint temperature will automatically revert to its initial preset value.



# **User setting**

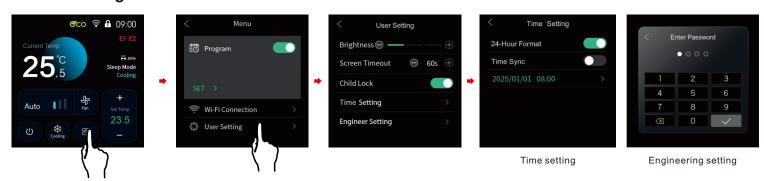

Item	Default	Description			
Brightness	Level 1	Adjusting the display brightness allows you to adjust the luminance level to ambient conditions and user preferences.			
Screen Timeout	60s	The screen blanking function allows you to automatically turn off the display after a specified period of time. This allows the device to save energy and reduce unnecessary lighting, especially at night. (Setting range:60s,90s,120s,150s,180s)			
Child Lock	OFF	To prevent accidental operation by children, users can enable the child lock function. Once enabled, the child lock icon " 🔒" will be displayed on the main screen. When the screen is turned off, it will be locked. Upon turning the screen back on, the main interface will appear, but any attempt to operate controls will prompt for a password (child lock password: 2301). If no operation is performed within 60 seconds, the system will automatically return to the main interface.			
	ON	ON: 24-Hour clock; OFF: 12-Hour clock			
Time setting	ON	ON: Timer sync(device will correct time based on network after connected Wifi) Factory default: 2025/01/01 08:00 OFF: Manually adjust the time.			
Engineering Setting	/	The password "1230"			

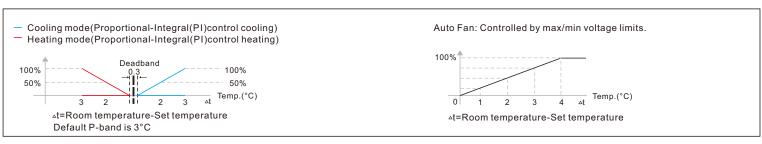

# Engineering Parameter Table (Engineering Password: 1230)

NO.	Parameter name	Option	Default	Description
1	Rs485 address	1~254	1	RS-485 communication address
2	Baud rate	4800/9600/19200/38400	1	RS-485 baud rate
3	Temperature calibration	-5~+5°C	0	Sensor calibration(external sensor is not available)
4	Maximum setpoint	20~35°C	35°C	It could set the maximum setpoint temperature range
5	Minimum setpoint	5~20°C	18°C	It could set the mainimum setpoint temperature range
6	Power-off memory	ON/OFF	OFF	ON: After a power outage and subsequent restoration, the thermostat will return to its previous state before the power loss.  OFF: After a power outage and subsequent restoration, the thermostat will remain in the OFF state.
7	Fan delay off	0/30/60\$	308	After the valve is closed, the fan remains on for a delay to dissipate residual heat from the coil.
8	Fan stop option(H)	ON/OFF	ON	ON: Fan and valve switch on/off simultaneously OFF: The fan runs at low speed when the valve is closed.
9	Fan stop option(C)	ON/OFF	OFF	ON: Fan and valve switch on/off simultaneously OFF: The fan runs at low speed when the valve is closed.
10	2/4 pipe option	2/4	2	2: Two-pipe system 4: Four-pipe system
11	System type	CO/CO&HE	CO&HE	System mode option CO: Cooling+Ventilation CO&HE: Cooling+Heating+Ventilation
12	External input	NO/Sen/Card	NO	No: Temperature is detected by the internal sensor. Sen:Temperature is detected by the external sensor.(It should be NTC100K) Card:Room card occupancy signal
13	ECO heat	5~35°C	18°C	When the room card indicates unoccupied status, the system switches to energy-saving
14	ECO cool	5~35°C	28°C	temperature.
15	Program option	Timer/PROG/OFF	PROG	Timer: scheduled thermostat on/off PROG: Programming function OFF: Sleep function
16	°C/°F	°C/°F	°C	Temperature unit
17	Proportional band	1~5°C	3	Valve opening proportional band
18	Min valve open	1~5V	1	Minimum valve opening: If the calculated opening is less than the minimum opening, the output voltage will be 1V.
19	Valve interval	30~300S	60S	Run time interval when activate actuators

# Modbus

Add- ress	Description	Read/ Write	Options					
0	Power on/off	R/W	0: OFF, 1: ON					
1	Setting temperature	R/W	5~35°C					
2	Fan speed	R/W	0: Auto, 1: Lower, 2: Medium, 3: High					
3	Mode	R/W	1: Cooling 2: Heating 3: Ventilation					
4	Key lock	R/W	0: Disabled 1: Enabled					
5	Sleep mode	R	0: Disabled 1: Enabled					
6	Room temperature	R	0~70°C					
7	Room humidity	R	0~99%, FF: No humidity function					
8	External sensor temp.	R	0~70°C, FF: No external sensor function					
9	Room card status	R	0: Unoccupied 1: Occupy FF: No room card function					
10	Alarm	R	0: No alarm 1: Internal sensor error 2: External sensor error					
11	Rs485 address	R/W	1~254					
12	Baud rate	R/W	0:4800 1:9600 2:19200 3:38400					
13	Temperature calibration	R/W	-5~+5°C					
14	Maximum setpoint	R/W	20~35°C					

15	Minimum setpoint	R/W	5~20°C					
16	Power-off Memory	R/W	0: ON 1: OFF					
17	Fan delay off	R/W	0/30/60\$					
18	Fan stop option(H)	R/W	0: ON, 1: OFF					
19	Fan stop option(C)	R/W	0: ON, 1: OFF					
20	2/4 pipe option	R/W	0: Two-pipe, 1: Four-pipe					
21	System type	R/W	0: CO, 1: CO&HE					
22	External input	R/W	0: Internal sensor 1: External sensor 2: Room card					
23	ECO heat	R/W	5~35°C					
24	ECO cool	R/W	5~35°C					
25	Program option	R/W	0: Sleep 1: Timer 2: Programming					
26	Temperature unit	R/W	0: °C 1: °F					
27	Proportional band	R/W	1~5°C					
28	Min valve open	R/W	1~5V					
29	Valve interval	R/W	30~300S					

### **Link with APP**

#### Registration and login:

- Click App store(click Android application market)
- 2 Search "TuyaSmart" and download.
- 3 Click the "Register" to create account. When you finish the register, log in your mailbox and click on the link to activate your account, then can login APP.



Tips: Turn on the Wifi and Bluetooth of your smartphone.

#### For the device:























- 1. Click" + ", click "Add Device".
- 2. Click your device.
- 3. Enter your wifi account and password, click "Next"
- 4. Adding...

5. Click "Done", it means device added successfully.





Program interface Click the target period to set the time and temperature

# Voice command :

\* Tips: you need connect to the Google and Alexa speaker. After waking up the speaker, you can say:

#### Amazon Alexa

- \* Alexa, open <device name>
- \* Alexa, close <device name>
- \* Alexa,make it cooler in <device name>.
  - \* Alexa,set <device name>to twenty.
  - \* Alexa,set <device name> to <mode value>.
- \* Alexa, make it warmer in <device name>. \* Alexa, what is the temperature of <device name>.

### Google Assistant

- \* OK,Google.turn on <device name>.
- \* OK,Google. make it warmer in <device name>.
- \* OK,Google.turn off <device name>.
- \* OK,Google. make it cooler in <device name>. \* OK,Google. set <device name> to <mode value>.
- \* OK,Google.set <device name> to 16 degrees. \* OK, Google. what is the temperature of <device name>.

\* The temperature unit of thermostat and speaker must be the same.